
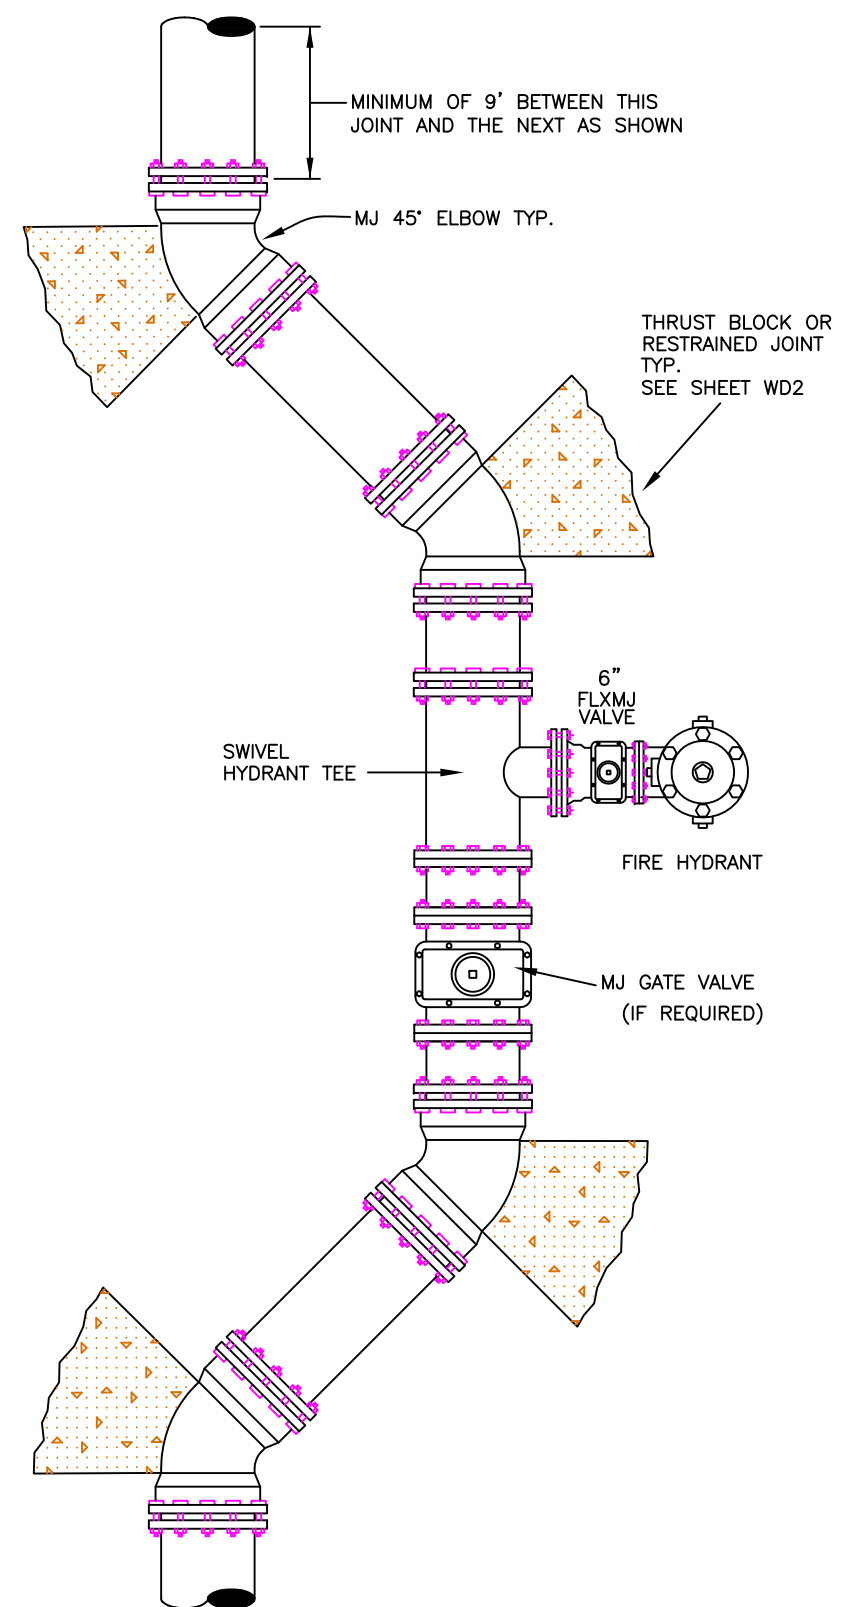


ELEVATION

**A TYPICAL FIRE HYDRANT**

NOT TO SCALE

1. A BREAKAWAY FLANGE IS REQUIRED ON FIRE HYDRANT BASE FLANGE.
2. FIRE HYDRANT LOCATIONS AS SPECIFIED ON PLAN SHEETS.
3. EXCAVATION SHALL CONFORM TO OSHA STANDARDS.
4. ALL FIRE HYDRANTS SHALL BE PLUMB.
5. ALL FIRE HYDRANTS SHALL RECEIVE 3 LAYERS 6 MIL POLYETHYLENE SHEETING AROUND BURIED BARREL PORTION.
6. ORIENT PUMPER NOZZLE PER ENGINEERS DIRECTIONS.

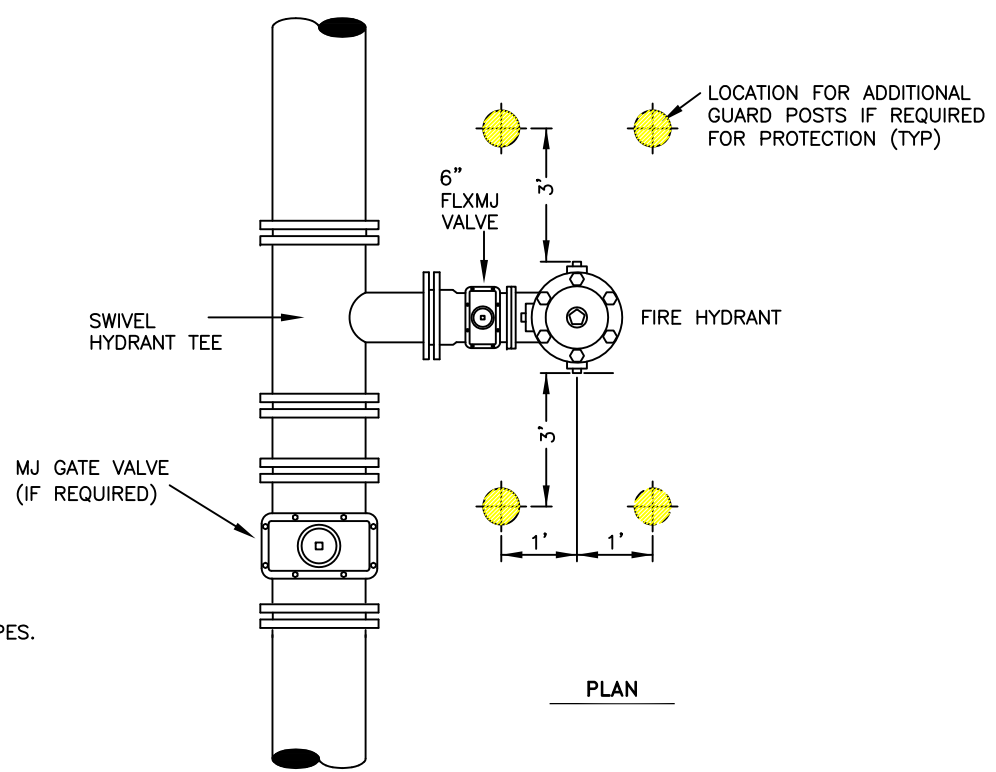

**B OFFSET FIRE HYDRANT**

NOT TO SCALE

JAN 07	UPDATE	MJB
4/09/02	UPDATE	MJB
DATE	REVISION	BY

PLAN SCALE: NOT TO SCALE

DESIGNED	APPROVED
DRAWN	
CHECKED MJB	USA ENGINEER
DATE FEB 1998	FILE: STANDARD DETAILS WD1

